


ZU UW48LA1 [UUD3.U30]

To replace the heat exchanger, the components of the box below are required.

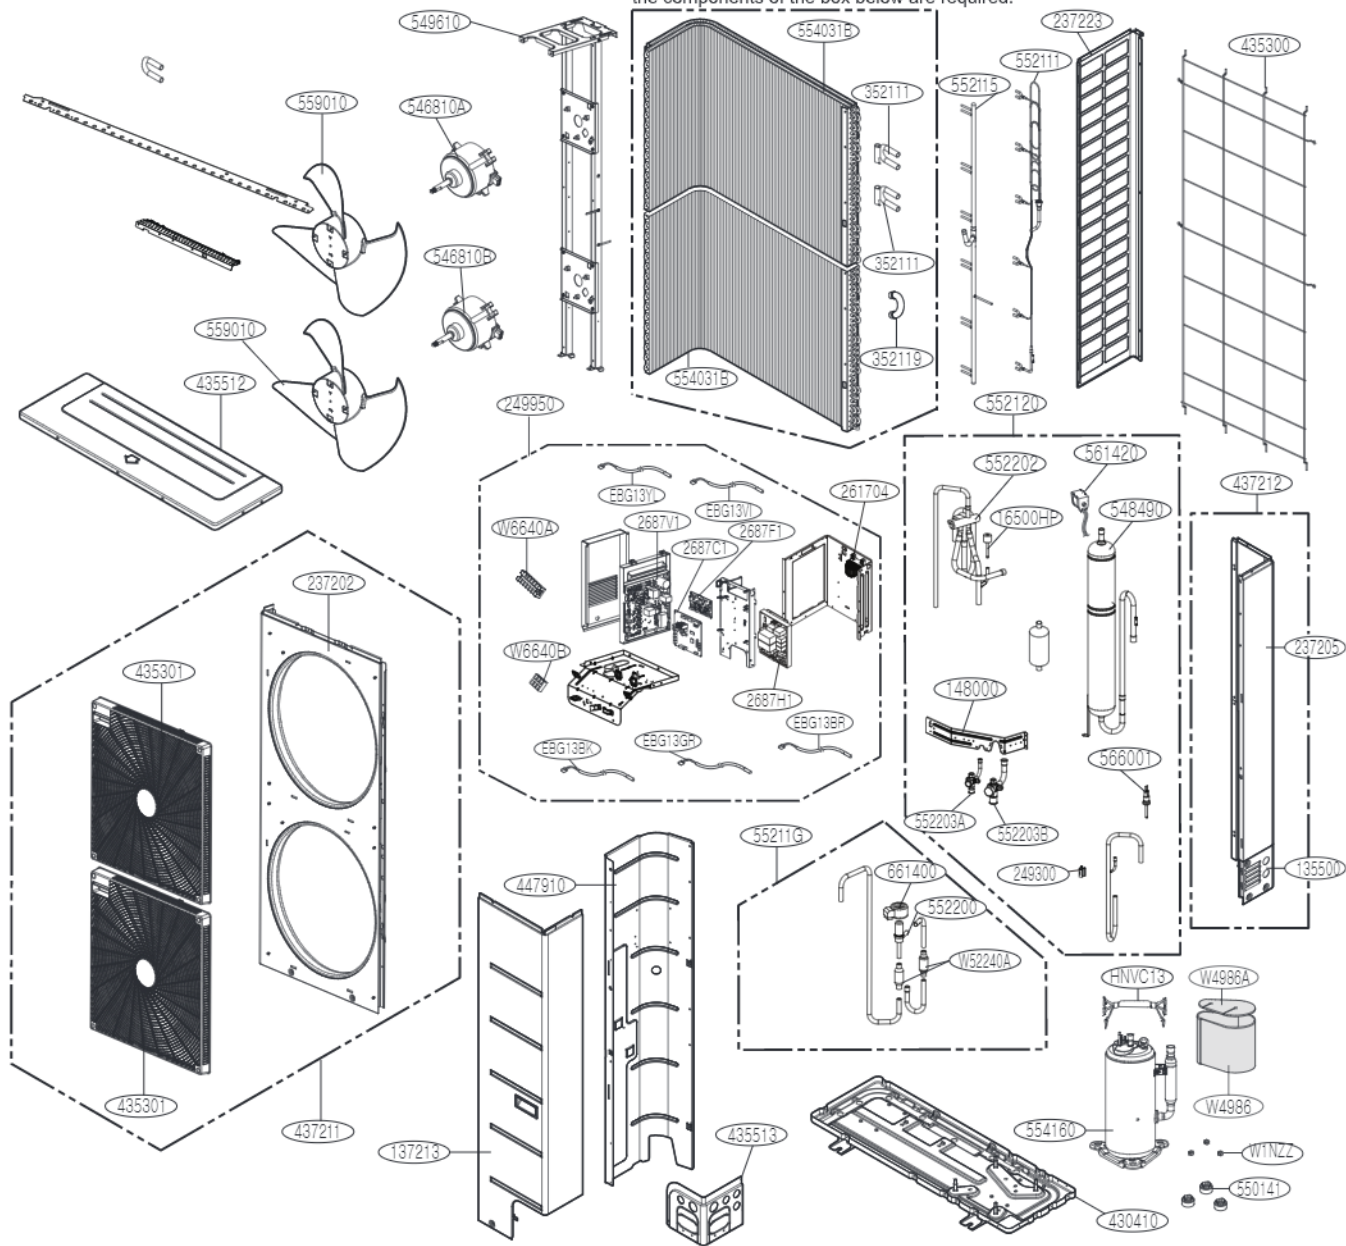

Location No.	Description	Sensor Information	Housing Color
EBG13GR	CN_SUCTION_GR	Suction pipe	Green
EBG13BK	CN_DISCHA_BK	Discharg pipe	Black
EBG13YL	CN_AIR_YL	Air	Yellow
EBG13BR	CN_MID_BR	Condensor Mid	Brown
EBG13VI	CN_C_PIPE_VI	Condensor Out	Violet
165000	CN_H_PRESS_RD	Pressure Sensor	Red