


Outdoor Unit : AHUW036A2

● Condenser Assembly Final Required Part

Level	Description	SVC Loc	Q'ty
...3	Condenser Assembly,Bending	554031	1
...3	Tube Assembly,Connector	352111B	1
...3	Tube Assembly,Connector	352111A	1
...3	Tube Assembly,Manifold(Outdoor)	552115	1
...3	Tube Assembly,Condenser(Out)	552113	1

● Condenser Assembly Final

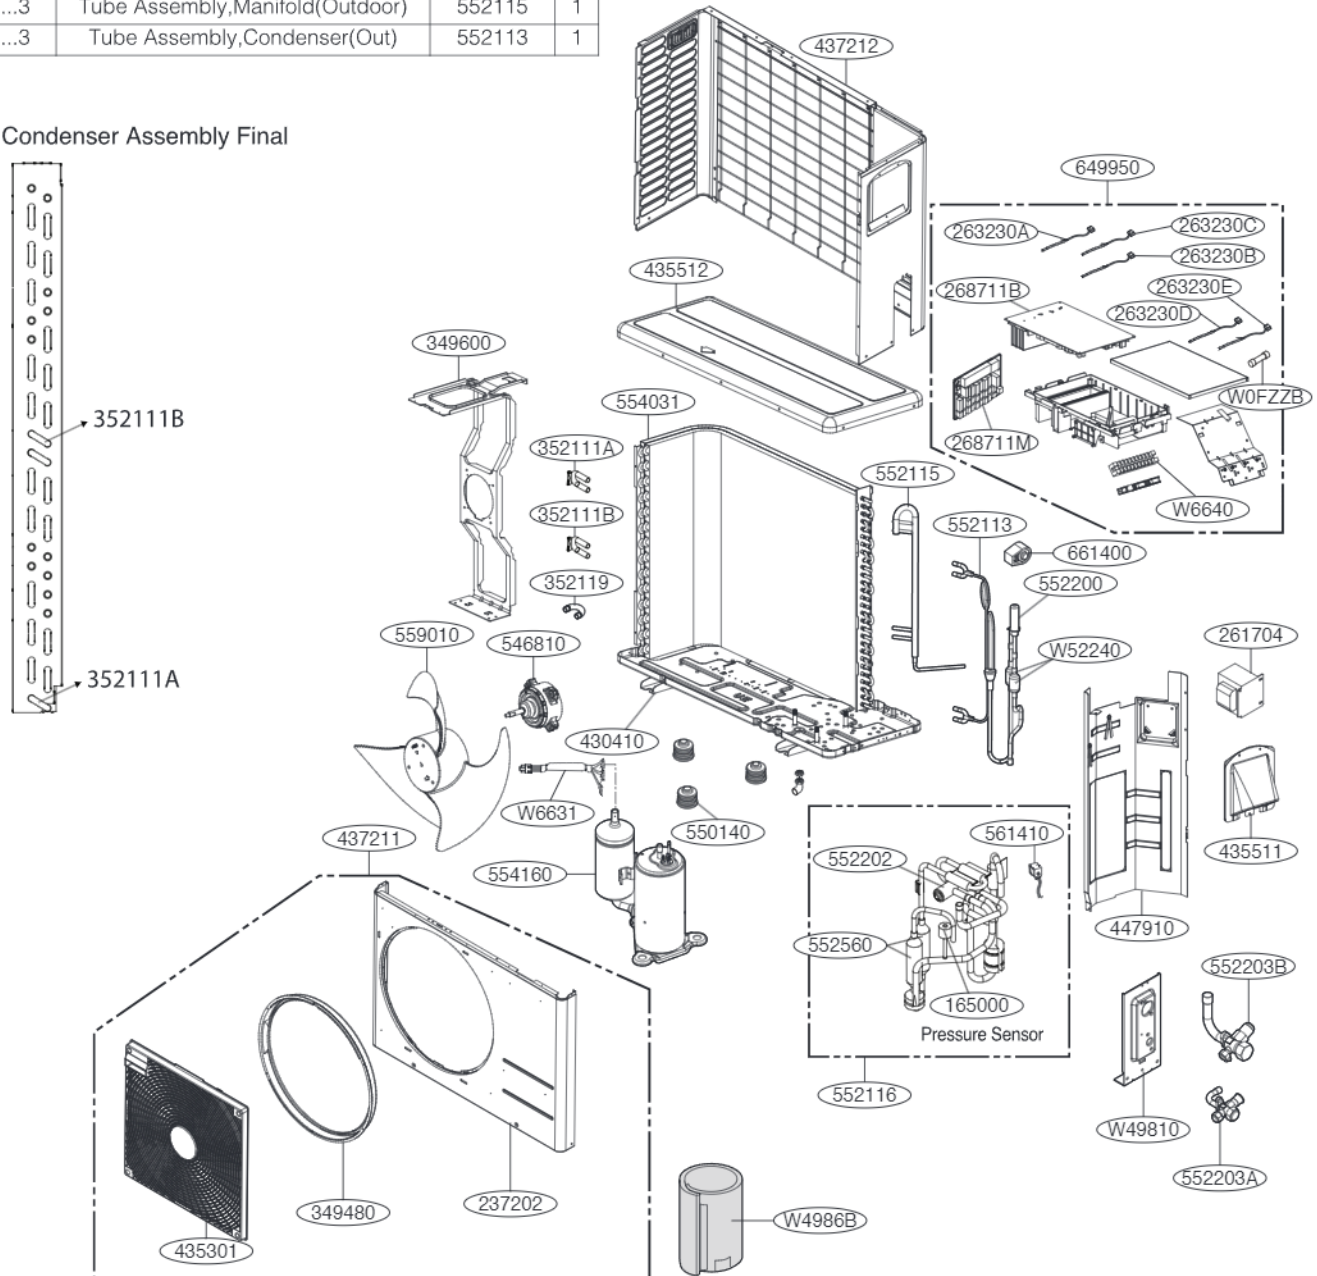

Location No.	Description	Sensor Information	Housing Color
263230A	Thermistor1(CN_DISCHARGE)	Discharge pipe	Black
263230B	Thermistor2(CN_SUCTION)	Suction Pipe	Green
263230C	Thermistor3(CN_C/PIPE)	Eva out pipe	Violet
263230D	Thermistor4(CN_Mid)	Cond-Mid	Brown
263230E	Thermistor5(CN_Air)	Air	Yellow
165000	Pressure sensor(CN-TH1)	Pressure Sensor	Red