


Outdoor Unit : AHUW056A2.EWGBEEU

● Condenser Assembly Final Required Part

Level	Description	SVC Loc	Q'ty
..2	Condenser Assembly,Bending	554031	1
..2	Tube Assembly,Manifold(Outdoor)	552115	1
..2	Tube Assembly,Condenser(Out)	552113	1

● Condenser Assembly Final

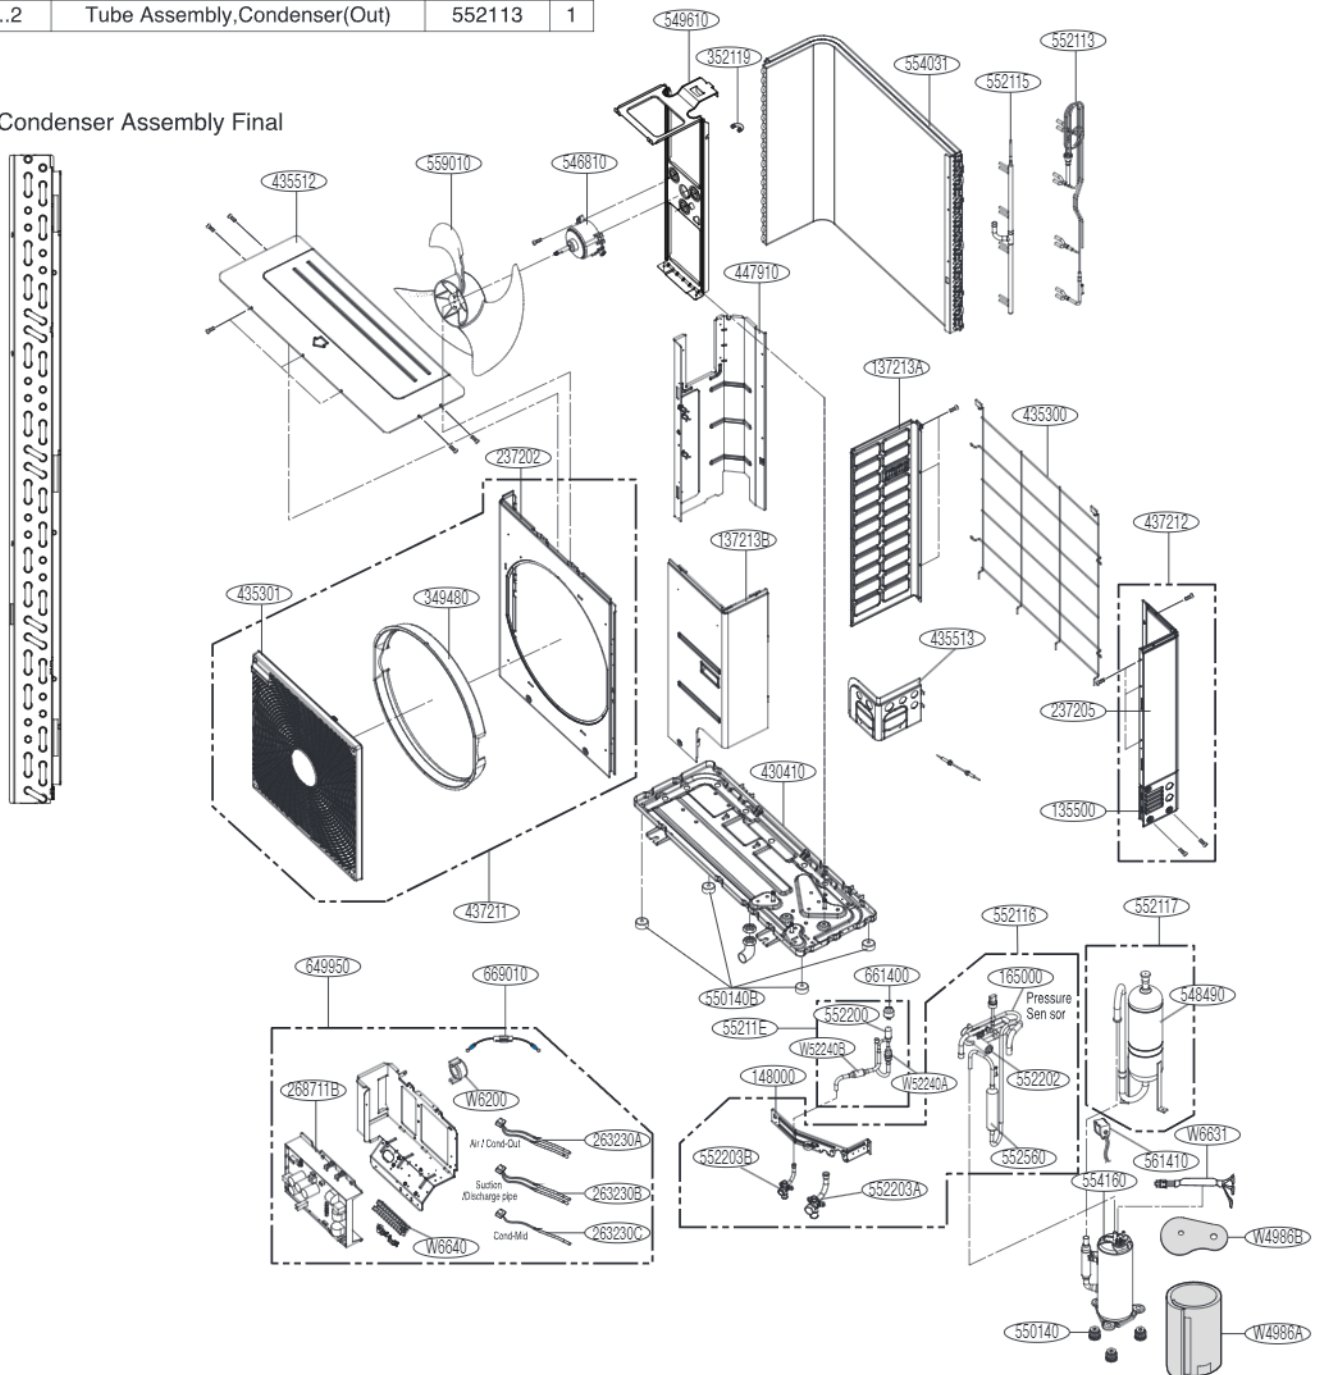

Location No.	Description	Sensor Information	Housing Color
263230A	Thermisther1(CN-TH2)	Air / Cond-Out	White
263230B	Thermisther2(CN-TH3)	Suction /Discharge pipe	Red
263230C	Thermisther3(CN-TH4)	Cond-Mid	Orange
165000	Pressure sensor(CN-TH1)	Pressure Sensor	Red